


The section of the hydrant is NOT to be painted. The Fire Department and the Douglasville/Douglas County Water & Sewer Authority will be adding a reflector.

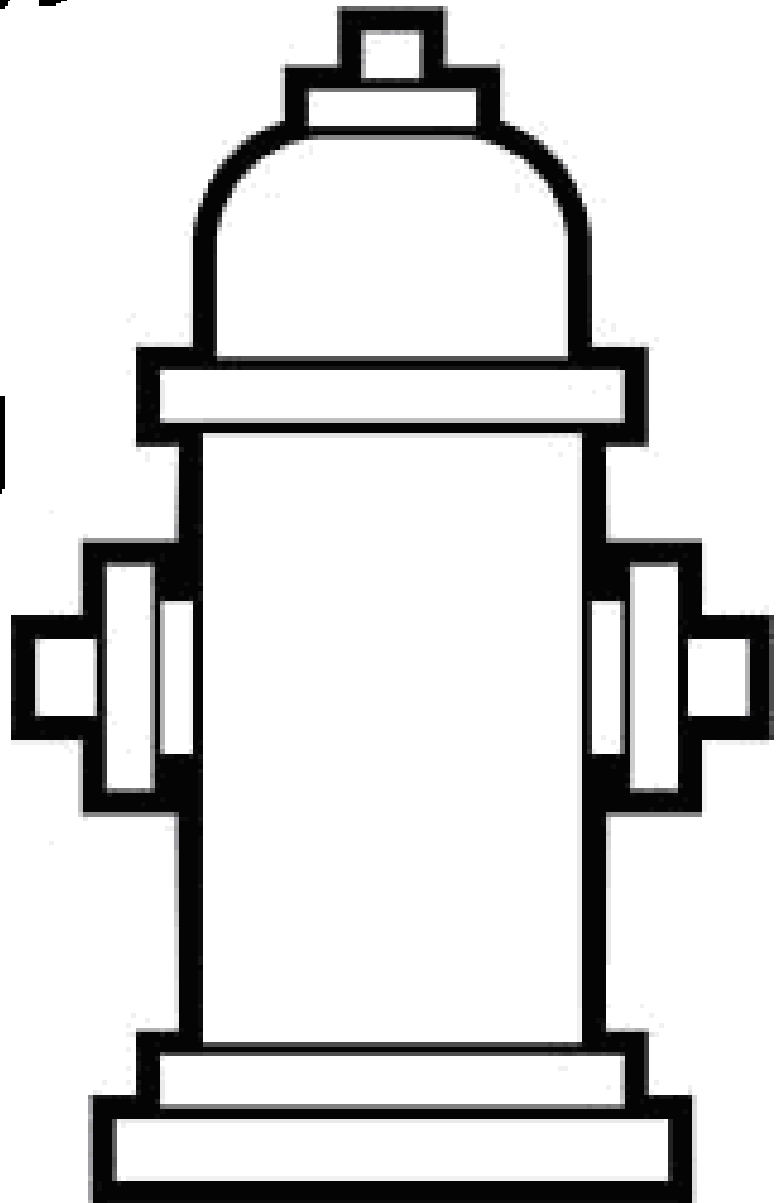

The THREADS of the hydrant are NOT to be painted. The Fire Department and the Douglasville/Douglas County Water & Sewer Authority must be able to thread their hose lines to the hydrant and paint prevents this.

CAC USE ONLY
Submission # _____
Date: _____